


TDSGAPC14 Pipe Mount Grounding Bus


Pipe Size Range: 1.9 to 2.5 inch actual diameter (1.5 to 2 inch, Schedule 40)

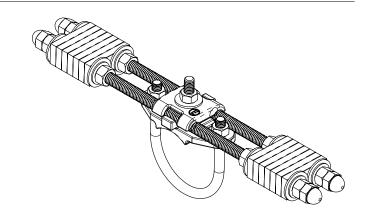

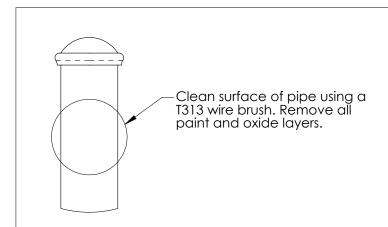


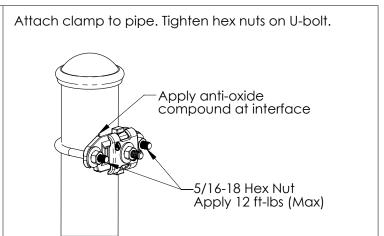

Install threaded rods by loosening hex nut on connector. Snug hex nut by hand such that the rods do not fall from the connector. Do not tighten hex nut.

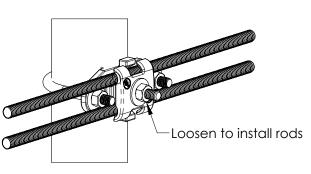

Install inner hardware.

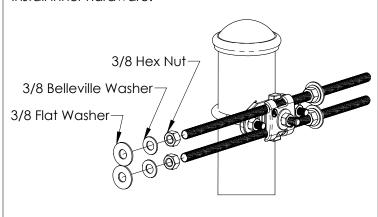

WARNING:

1. ERICO products shall be installed and used only as indicated in ERICO product instruction sheets and training materials. Instruction sheets are available at www.erico.com and from your ERICO customer service representative.

2. ERICO products must never be used for a purpose other than the purpose for which they were designed or in a manner that exceeds specified load ratings.

3. All instructions must be completely followed to ensure proper and safe installation and performance.

4. Improper installation, misuse, misapplication or other failure to completely follow ERICO's instructions and warnings may cause product malfunction, property darks excitately bodilly injury and death damage, serious bodily injury and death.

All governing codes and regulations and those required by the job site must be observed.

Always use appropriate safety equipment such as eye protection, hard hat, and gloves as appropriate to the application.


1 OF 2

CADDY, CADWELD, CRITEC, ERICO, ERIFLEX, ERITECH, and LENTON are registered trademarks of ERICO International Corporation.





Install lugs and spacers. Crimp lugs and wires together prior to install. Apply anti-oxide compound to both sides of each lug.

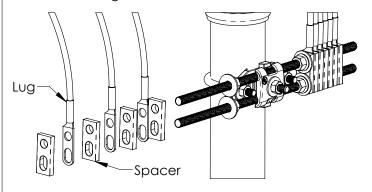

Maximum Lug Size: 6 AWG, two-hole lugs

Install outer hardware. Do not tighten.


3/8 Flat Washer

3/8-16 Hex Nut

Belleville Washer


3/8-16 Acorn Nut

Tighten hex nut on rod connector.

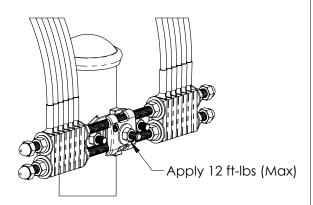

Note: In the absence of a torque wrench, snug bolt and tighten 1/4-turn.

Tighten inner and outer hardware.

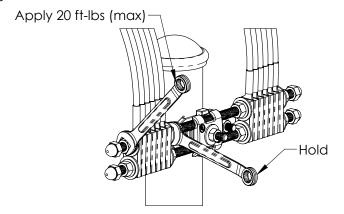

Note: In the absence of a torque wrench, snug bolt and tighten 1/4-turn.

The grounding bus must be electrically connected to the grounding system. Down-conductors may be used to connect the grounding bus to the grounding system (6 AWG or larger). When using a CADWELD® exothermic connection to connect the structure to the grounding system, remove the galvanized coating prior to welding.

After installation and welding are complete, cover exposed steel with cold galvanized coating (T372A, T358 or equivalent) if attached to a galvanized steel pipe.





2 OF 2