




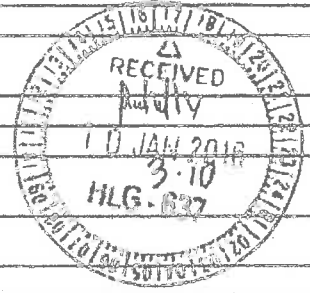
R

<b>EMPLOYER</b> ROADS AND TRANSPORT AUTHORITY هيئة الطرق و المواصلات ROADS & TRANSPORT AUTHORITY	<b>CONSULTANT</b> LOUIS BERGER  <b>Louis Berger</b>	<b>CONTRACTOR</b> HABTOOR LEIGHTON GROUP 
---	--	--




**MATERIAL APPROVAL FORM**

MATERIAL SUBMISSION : R1011-2-HLG-MS-0067 : SUBMISSION NO. : Rev. 00 PREVIOUS SUBMISSION REF : (IF SUBMITTED)	
CLIENT : <u>ROADS &amp; TRANSPORT AUTHORITY</u> CONSULTANT : <u>LOUIS BERGER COMPANY</u> CONTRACTOR : <u>HABTOOR LEIGHTON GROUP</u> PROJECT : <u>UPGRADE JUNCTIONS AT AIRPORT ROAD</u> PROJECT NO. : <u>R1011/2</u>	received 05/01/16 10:40a 

<b>DESCRIPTION</b>	Mechanical Coupler (Lenton) Splicing of Steel Reinforcement (Structural Work) 1) Standard Couplers (A2) for 25 and 32 mm steel) 2) Position Couplers (P9) for (25 mm and 32 mm steel)
<b>DATE OF SUBMISSION</b>	4-Jan-16
<b>DATE OF APPROVAL</b>	ASAP
<b>REQUESTED BY DATE</b>	
<b>B.O.Q REF</b>	d/ 7/ 21, d /7 /38
<b>SPECIFICATION REF</b>	General Specifications Volume 2 Part 1 Section 4/ 11
<b>DRAWING NO &amp; STATUS</b>	All relevant Drawing
<b>CONSTRUCTION DRAWING</b>	
<b>NAME &amp; ADDRESS OF MANUFACTURER</b>	Erico Manufacturing
<b>LOCAL AGENT</b>	Max Steel Industry LLC Dubai, UAE
<b>TECHNICAL LITERATURE</b>	As Attached
<b>SAMPLE</b>	As Per Requirement



<b>CONTRACTOR:</b> HABTOOR LEIGHTON GROUP <b>CONSULTANT:</b> LOUIS BERGER COMPANY <input type="checkbox"/> APPROVED <input checked="" type="checkbox"/> APPROVED AS NOTED <input type="checkbox"/> RESUBMIT <input type="checkbox"/> REJECTED	<b>NAME:</b> MAMOUN SHAHIN <b>CLIENT:</b> DUBAI ROADS & TRANSPORT AUTHORITY <input type="checkbox"/> APPROVED <input checked="" type="checkbox"/> APPROVED AS NOTED <input type="checkbox"/> RESUBMIT <input type="checkbox"/> REJECTED
--	--

<b>Consultant Comments:</b> Source is extremely approved for the RTA project R1011/2 The propose Coupler must be satisfy the requirements of structural steel manufacturer technical literature Material to be tested at OCL against above mentioned previous test at site. Coupler to be used on site as approved by our site structural staff to be checked before use. 10/1/16	<b>Client Comments:</b> Accepted as Recommended by Consultant and subject to his comments in addition:- * Random Samples to be collected throughout for quality testing * Consultant Approval to be obtained for every single use.  10/1/2016
<b>AUTHORISED SIGNATURE &amp; DATE</b>  10/1/16	<b>AUTHORISED SIGNATURE &amp; DATE</b>  10/1/2016

NOTE : 1 RTA no objection does not relieve either the Consultant or Contractor of their responsibilities Under the Consultancy Agreement of Contract.  
 2. All relevant test results required by specification to be attached

05/01/16  
10:40a